



IMPROVEMENT OF POWER QUALITY BY USING A ROBUST HYBRID SERIES ACTIVE POWER FILTER

***DUMPALA SWAMY **MD YASIN**

1.PG SCHOLAR,DEPARTMENT OF EEE, VAAGDEVI COLLEGE OF ENGINEERING(UGC-AUTONOMOUS, ACCREDITED BY NBA)

2. ASSISTANT. PROFESSOR, DEPARTMENT OF EEE, VAAGDEVI COLLEGE OF ENGINEERING(UGC-AUTONOMOUS, ACCREDITED BY NBA)

ABSTRACT: In this paper, Design of Hybrid series active filter (HSAF) for Harmonic reduction and reactive power compensation in single phase systems is represented. The HSAF consists of the series combination of two single tuned LC filters which are tuned to 3rd and 5th harmonics and an active filter. Discrete Fourier transformation is used as the control technique. Simulation results using MATLAB shows the effectiveness of control technique. On getting the simulation results the value of THD is very low (2.75%), which is very negligible. So the power quality is said to be improved.

Keywords: Hybrid series active filter, active filter, harmonic reduction, reactive power compensation, Discrete Fourier transformation, power quality.

I. INTRODUCTION With the wide use of power electronic equipments and nonlinear loads, the power quality has been lost in distribution system. Current harmonics cause serious harmonic problems in distribution feeders for sensitive consumers. Some technology solutions have been reported in order to solve power quality problems. Initially, lossless passive filters have been used to mitigate harmonics and for compensation of reactive power at nonlinear loads. However, passive filters have the drawbacks of fixed compensation, large size and resonance with the supply system. Active filers have been explored in shunt and series configurations to compensate different types of nonlinear loads; nevertheless, they have some demerits. As a case in point, their power rating is sometimes close to load, and thus it becomes a costly option for power quality improvement. Many analysts have classified various types of nonlinear loads and have



suggested different filter options for their compensation. In response to these factors, a series of hybrid filters has been evolved and widely used in practice as a cost effective solution for the compensation of nonlinear loads. Mainly shunt active filters consisting of voltage-fed pulse width modulated (PWM) inverters using IGBT or GTO thyristors are operating successfully in all over the world. These filters provided the required harmonic filtering, reactive power compensation, and etc [1-2]. The most important technology for the power quality improvement is the detecting method of harmonics to decrease the capacity of the various energy storage components. Different control methods are presented in recent publications for this type of active filters [3-16]. The control method presented in this thesis is depends upon the calculation of the real part of the fundamental load current while this is helpful in some configurations such as hybrid series active filter, since it cannot compensate reactive power completely and needs many complicate calculations. The active power filter proposed in this thesis uses a dc capacitor voltage closed- loop control and used a modified phase-locked loop for extraction of the reference current. In the cited references, the computation involves various control parameters or needs complex calculations. Also, the dynamic performance of the compensator is not desire in the case of fast-changing loads. The least compensation current control method presented in [9] is based on detection of the harmonics and reactive current of the active power filter. In [10], genetic algorithm and extended analysis optimization techniques were applied for switched capacitor active filters. The combined genetic algorithm/conventional analysis control methods [11] have been considered as a recent control approach. These control methods have a common demerit of concerning the global stability of the closedloop system. In [12], the control technique is based on the calculation of average power; this wants to know some information regarding system and requires some intense calculation. The sliding-mode control technique proposed in [13] solves the stability problem; however, the calculation technique for compensation of current reference is complex and switching rate is variable. In [14], a digital repetitive control approach is presented to obtain high gain for the current loop; nevertheless, the control strategy in this method is based on a linearized replica of the active filter and does not direct to global stability. A deadbeat control strategy is presented in [15] for the current loop of single-phase active filters.



Even though this process has a rapid current control due to the deadbeat nature, its dependence on parameters is a basic drawback. Furthermore, the call for prediction of the current reference requires adaptive signal processing techniques, complicating the execution of this technique. Passivity based controllers [16] based on phasor models of system dynamics have also been projected in an attempt to improve the stability properties of active filters.

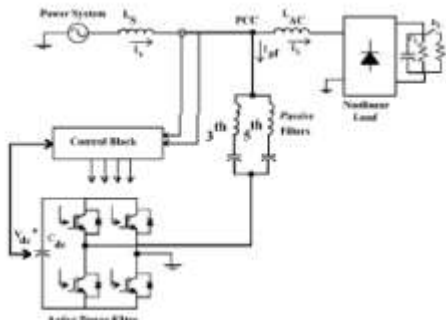


FIG : SYSTEM CONFIGURATION

PROPOSED SYSTEM

Harmonic voltage source in series with an impedance $Z_{Non-Linear}$ or by its Norton equivalent modeled with a harmonic current source in parallel to the impedance. The Thevenin's model and the Norton equivalent circuit are depicted in Fig. 4. In this paper, the common Norton equivalent is chosen to follow major related papers. The principle of such modeling is documented in [30]. In this paper, the approach to achieve optimal behavior during the time the grid is perturbed is implemented on the controller. The use of a passive filter is mandatory to compensate current issues and maintaining a constant voltage free of distortions at the load terminals. The nonlinear load is modeled by a resistance

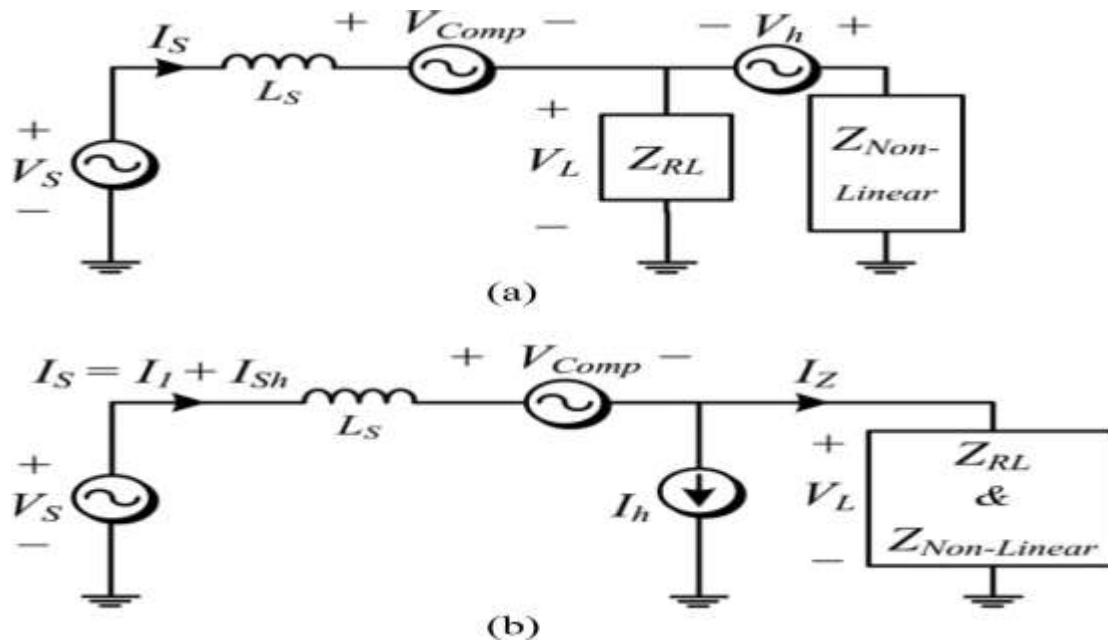


Fig. Single-phase equivalent phasor model for VSC type of loads. (a) Th'evenin's model. (b) Norton equivalent. representing the active power consumed and a current source generating harmonics current.

Accordingly, the impedance Z_L is the equivalent of the nonlinear ($Z_{Non-linear}$) and the linear load (Z_{RL}). The series active filter, whose output voltage V_{comp} is considered as an ideal controlled voltage source is generating a voltage based on the detecting source current, load voltage, and also the source voltage to achieve optimal results as of (4). This established hybrid approach gives good result and is quite less sensitive to the value of the gain G to achieve low level of current harmonics. The gain G is proportional to the current harmonics (I_{sh}) flowing to the grid. Assuming the grid contains voltage distortions, the equivalent circuit for the fundamental and harmonics are

$$V_S = V_{s1} + V_{sh} \quad (1)$$

$$V_L = V_{L1} + V_{Lh} = Z_L I_Z = Z_L (I_S - I_h) \quad (2)$$

$$I_S = I_{s1} + I_{sh} = I_Z + I_h \quad (3)$$

$$V_{Comp} = +GI_{sh} - V_{Lh} + V_{Sh} \quad (4)$$



where I_Z represents the load current in Z_L shown in Fig. 4. Using Kirchoff's law, the following equation is depicted for both the fundamental and harmonics:

$$V_S = Z_S I_S + V_{Comp} + V_L \quad (5)$$

$$V_{L1} = Z_L I_{S1}, V_{Lh} = Z_L (I_{Sh} - I_h). \quad (6)$$

By substituting the fundamental of (6) into (5), the source current at fundamental frequency is obtained:

$$I_{S1} = V_{S1} / Z_S + Z_L \quad (7)$$

By substituting (4) into (5) for the harmonic components, the harmonic source current is reached as follows:

$$V_{Sh} = Z_S I_{Sh} + G I_{Sh} - V_{Lh} + V_{Sh} + V_{Lh} \rightarrow I_{Sh} = 0. \quad (8)$$

By introducing (8) into the harmonic component of the load PCC voltage (6), the following equation is achieved:


$$V_{Lh} = -Z_L I_h. \quad (9)$$

Consequently, under this approach even in presence of source voltage distortions, the source current will remain clean of any harmonic components. To some extent in this approach, the filter behaves as high impedance likewise an open circuit for current harmonics, while the shunt high-pass filter tuned at the system frequency could create a low-impedance path for all harmonics and open circuit for the fundamental component. This argument explains the need of a hybrid configuration to create an alternative path for current harmonics fed from a current source type of nonlinear loads. The rating of the compensator is designed based on the required power consumers desire to restore during sags in the grid supply. For the 1.6-kVA load, in order to restore a 40% voltage sag, and at the same time, compensating source current harmonics and correcting the PF following sizing is suggested. The auxiliary supply should be designed accordingly as: $SDC_{source} = 1.6 \times 40\% = 650 \text{ VA}$. The converter should transfer the load RMS current and have the following characteristics: $I_{Converter} = I_L = 1.6 \text{ kVA} / 120 \text{ V}_{rms} = 13 \text{ Arms}$. The nominal voltage of the converter is then $V_{Converter} = 650 \text{ VA} / 13 \text{ Arms} = 50 \text{ V}_{rms}$. The dc bus voltage is then required to be $V_{DCsource} > 70 \text{ V}_{dc}$ and the more dc voltage is, the compensation will have a better performances. The bank of series-resonant tuned shunt passive




filters, assuming a 20% of fifth harmonic component, should have the following parameters: VSPF = 120 Vrms with a rated current of ISPF = 2.6 A. To have an optimized design, a primary study of the nonlinear load characteristic is required, and then, the same design process should be taken for the other tuned branches if required.


Simulation circuit:

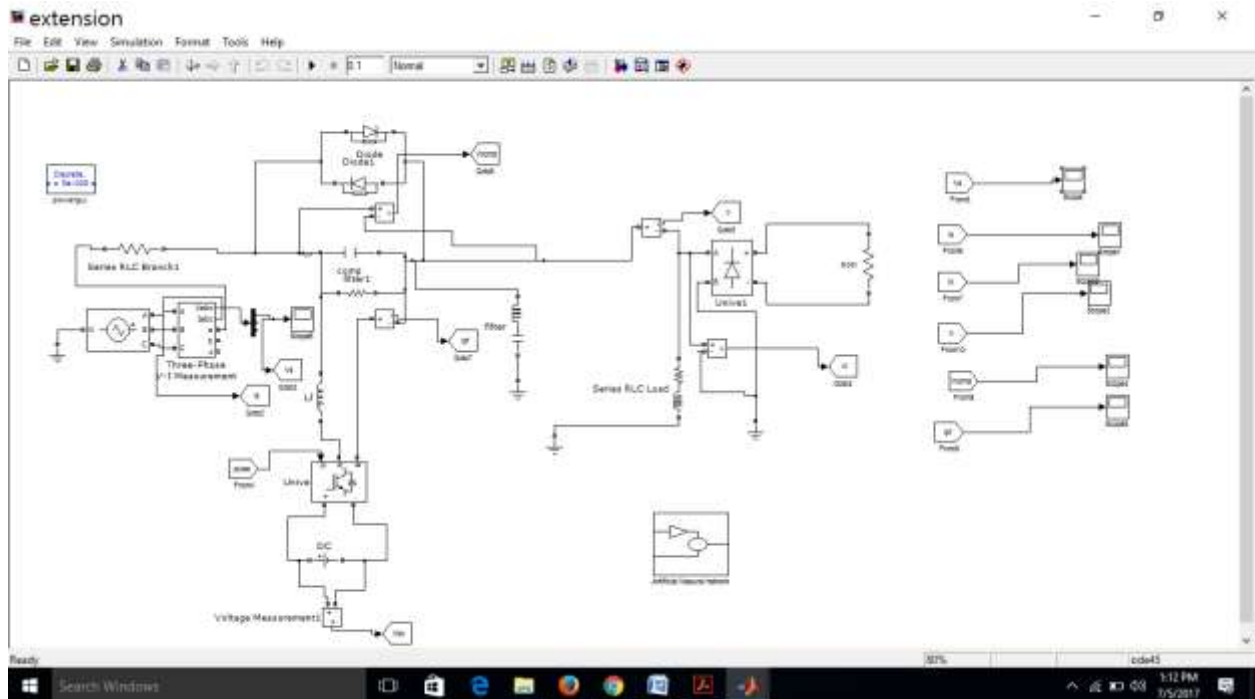


Source voltage:

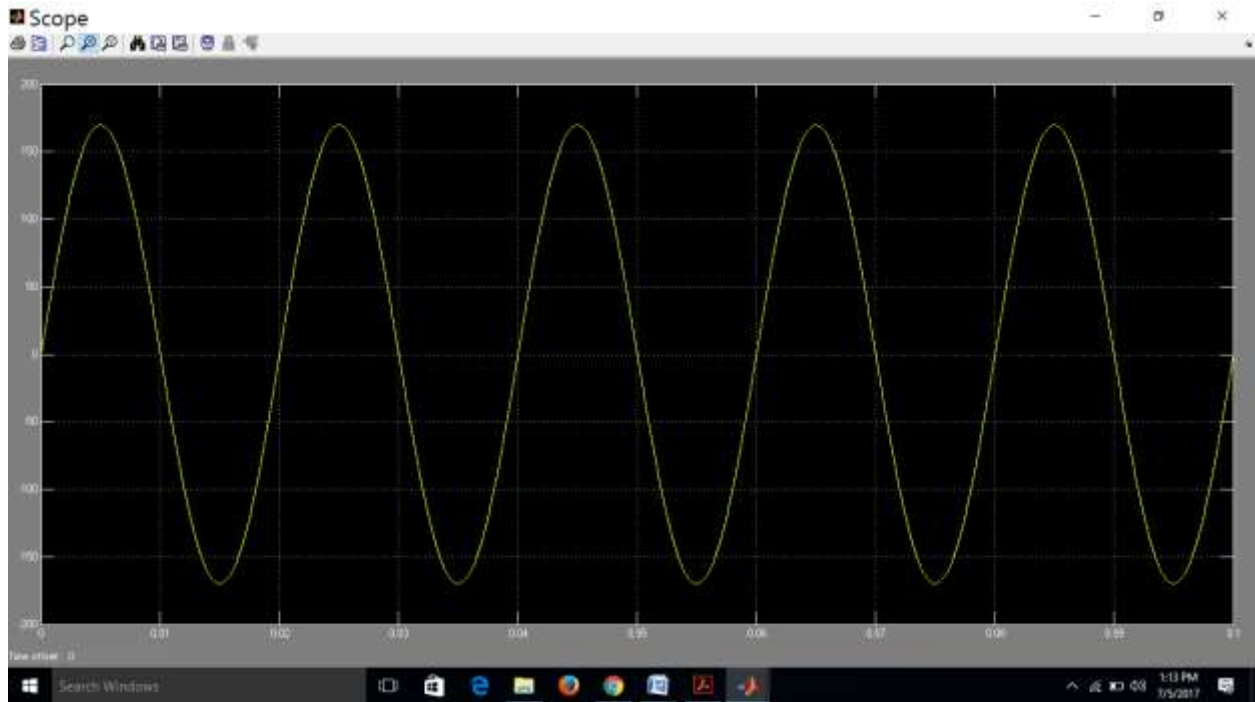

Source current:

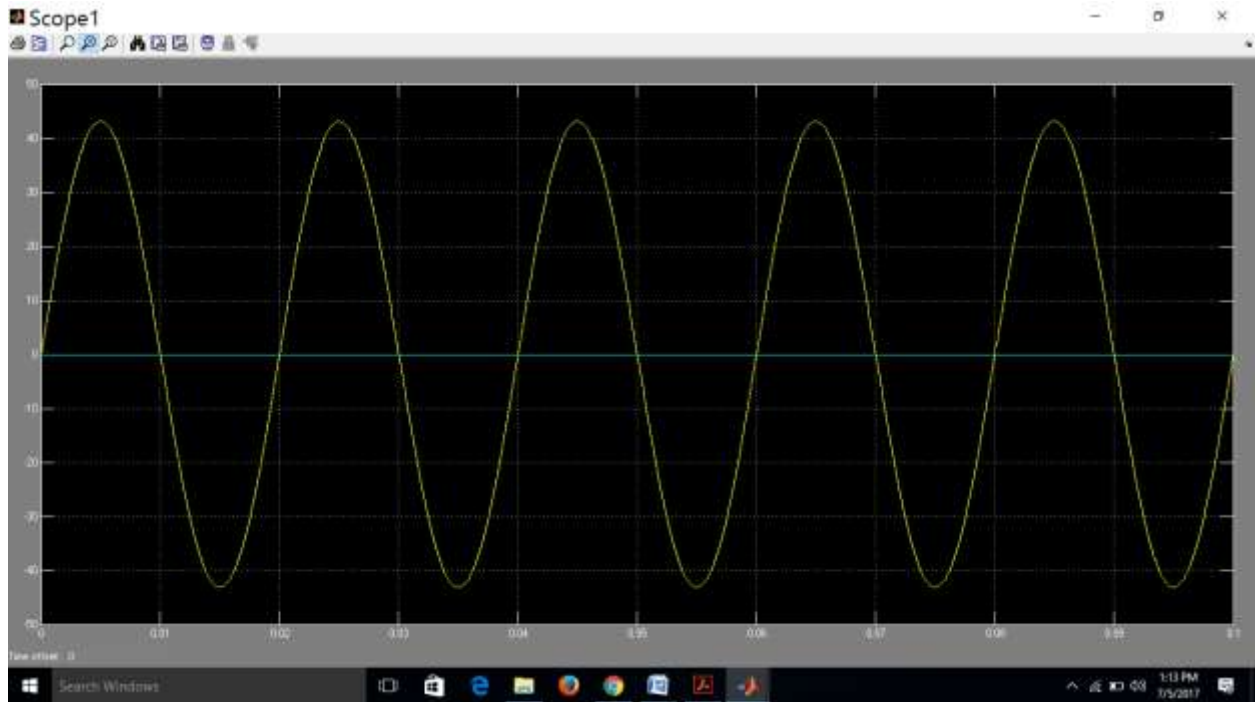


Voltage across non linear load:

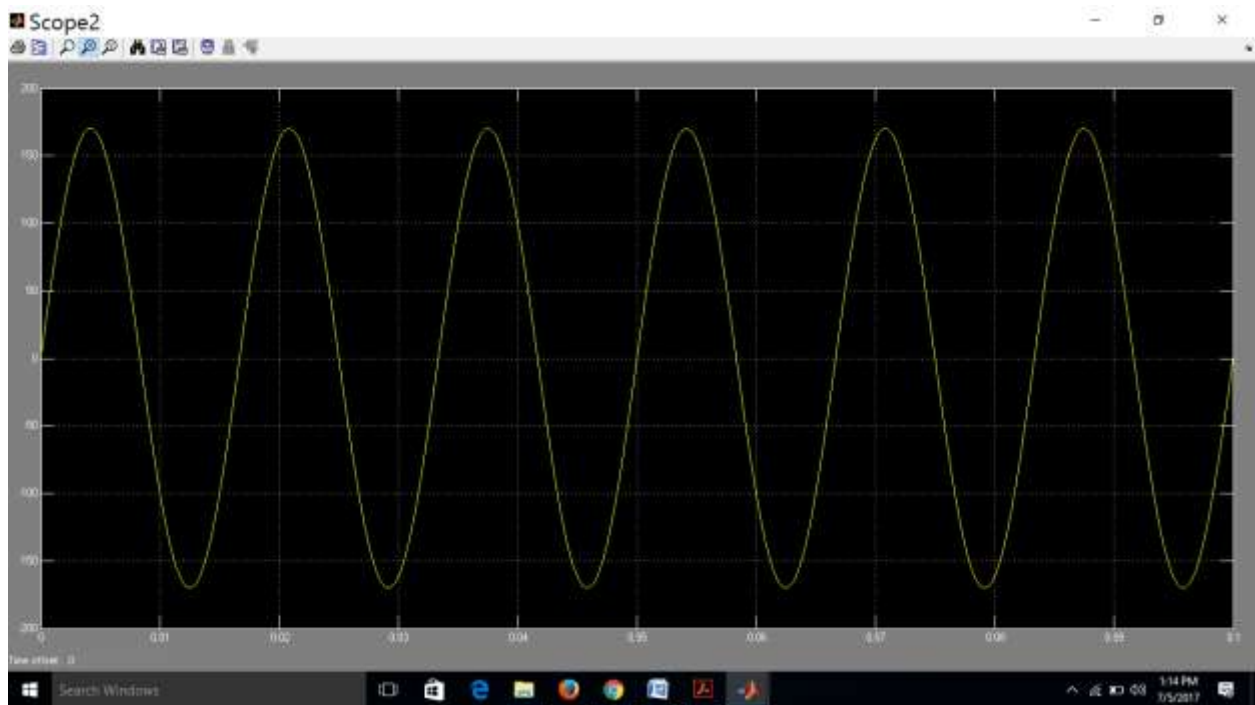




Current at load:

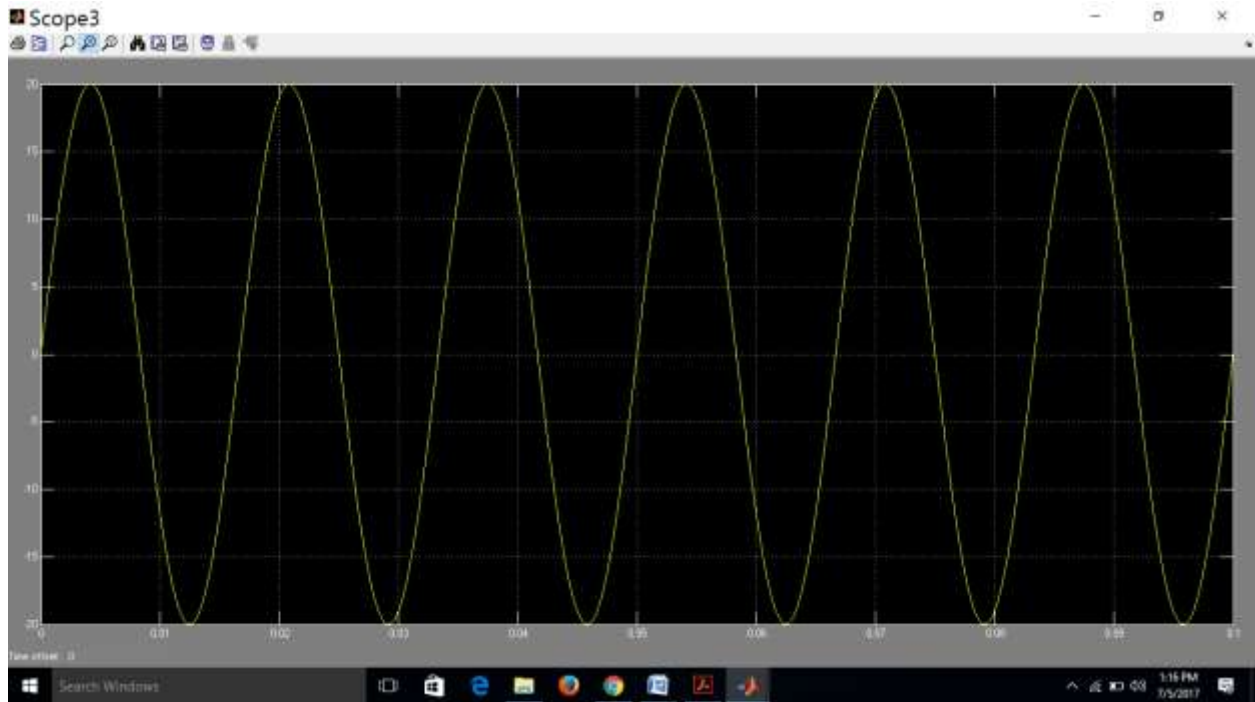

Voltage compensation:

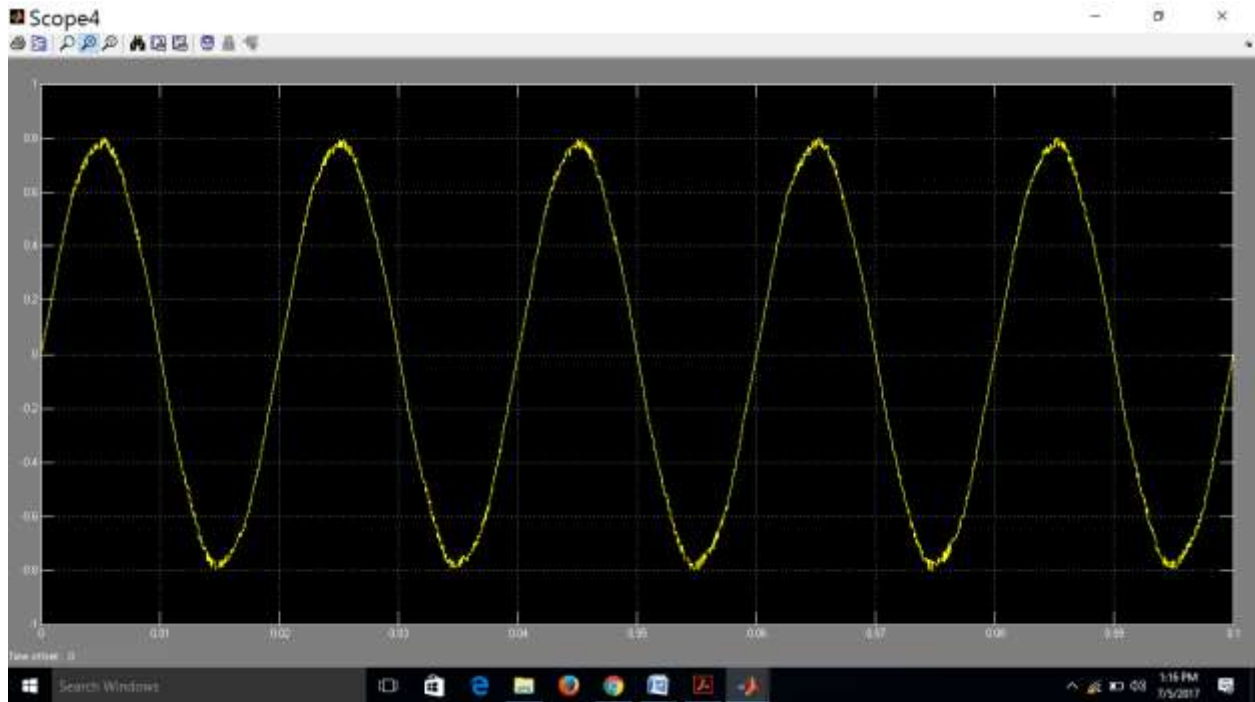

Current at h bridge:



CONCLUSION

In this paper, a novel THSeAF configuration with a slidingmode controller was proposed and tested to overcome power quality issues of a voltage fed type of nonlinear load. The theoretical modeling has been realized and simulated for further developments. A second-order SMC is developed and adapted for practical real-time implementations. A notch harmonic detection is implemented and tested to extract harmonic component of a polluted signal. The stability of the controller is also described and analyzed using Lyapunov criteria. It has been demonstrated that the proposed configuration along with the control approach is able to feature reactive power exchange with the utility as well. With regard to the control approach and taking advantage of the proposed robust structure, a harmonic-free voltage is delivered across the residential terminals. The whole system is implemented on a real-time simulator to ensure feasibility of the developed controller. It is worthy to mention that this topology does not make use of a bulky transformer, which is mandatory for series active/hybrid filters topologies; it has a natural feature of limiting short-circuit current during faulty condition. It also replaces the function of UPS/UPQC devices with much less reactive and semiconductor components. Results of the laboratory implementation have demonstrated that this active compensator responds to abrupt variations in the grid voltage by providing a constant and distortion-free supply to the load while eliminating grid current harmonics contributing to the improvement of the grid's power quality.



REFERENCES

- [1] B. Singh, A. Chandra, and K. Al-Haddad, *Power Quality Problems and Mitigation Techniques*. Chichester, U.K.: Wiley, 2015.
- [2] M. Liserre, T. Sauter, and J. Y. Hung, “Future energy systems: Integrating renewable energy sources into the smart power grid through industrial electronics,” *IEEE Ind. Electron. Mag.*, vol. 4, no. 1, pp. 18–37, Mar. 2010.
- [3] L. Jun-Young and C. Hyung-Jun, “6.6-kW onboard charger design using DCM PFC converter with harmonic modulation technique and two-stage DC/DC converter,” *IEEE Trans. Ind. Electron.*, vol. 61, no. 3, pp. 1243–1252, Mar. 2014.
- [4] J. Napoles, A. J. Watson, J. J. Padilla, J. I. Leon, L. G. Franquelo, and P. W. Wheeler, “Selective harmonic mitigation technique for cascaded H-bridge converters with nonequal DC link voltages,” *IEEE Trans. Ind. Electron.*, vol. 60, no. 5, pp. 1963–1971, May 2013.
- [5] S. Kouro, J. I. Leon, D. Vinnikov, and L. G. Franquelo, “Grid-connected photovoltaic systems: An overview of recent research and emerging PV converter technology,” *IEEE Ind. Electron. Mag.*, vol. 9, no. 1, pp. 47–61, Mar. 2015.
- [6] S. Munir and L. YunWei, “Residential distribution system harmonic compensation using PV interfacing inverter,” *IEEE Trans. Smart Grid*, vol. 4, no. 2, pp. 816–827, Jun. 2013.



- [7] A. Q. Ansari, B. Singh, and M. Hasan, “Algorithm for power angle control to improve power quality in distribution system using unified power quality conditioner,” *IET Gener. Transmiss. Distrib.*, vol. 9, pp. 1439–1447, 2015.
- [8] H. Akagi, “Active harmonic filters,” *Proc. IEEE*, vol. 93, no. 12, pp. 2128–2141, Dec. 2005.
- [9] A. Javadi and K. Al-Haddad, “A single-phase active device for power quality improvement of electrified transportation,” *IEEE Trans. Ind. Electron.*, vol. 62, no. 5, pp. 3033–3041, May 2015.
- [10] T. Yi, L. Poh Chiang, W. Peng, C. Fook Hoong, G. Feng, and F. Blaabjerg, “Generalized design of high performance shunt active power filter with output LCL filter,” *IEEE Trans. Ind. Electron.*, vol. 59, no. 3, pp. 1443–1452, Mar. 2012.
- [11] H. Akagi and K. Isozaki, “A hybrid active filter for a three-phase 12-pulse diode rectifier used as front end of a medium-voltage motor drive,” *IEEE Trans. Power Electron.*, vol. 27, no. 1, pp. 69–77, Jan. 2012.
- [12] W. R. Nogueira Santos, E. R. Cabral da Silva, C. Brandao Jacobina, E. de Moura Fernandes, A. Cunha Oliveira, and R. Rocha Matias, “The transformerless single-phase universal active power filter for harmonic and reactive power compensation,” *IEEE Trans. Power Electron.*, vol. 29, no. 7, pp. 3563–3572, Jul. 2014.
- [13] B. W. Franca, L. F. da Silva, M. A. Aredes, and M. Aredes, “An Improved iUPQC controller to provide additional grid-voltage regulation as a STATCOM,” *IEEE Trans. Ind. Electron.*, vol. 62, no. 3, pp. 1345–1352, Mar. 2015.
- [14] J. Tian, Q. Chen, and B. Xie, “Series hybrid active power filter based on controllable harmonic impedance,” *IET Power Electron.*, vol. 5, pp. 142–148, 2012.



[15] O. S. Senturk and A. M. Hava, “Performance enhancement of the singlephase series active filter by employing the load voltage waveform reconstruction and line current sampling delay reduction methods,” IEEE Trans. Power Electron., vol. 26, no. 8, pp. 2210–2220, Aug. 2011.